


LIGHTNING PROTECTION SYSTEM (roof mounted)



- NOTES: 1. THE PARATREAD SHOULD BE INSTALLED BY A SIPLAST SELECT CONTRACTOR.
2. THE INSTALLATION OF THE LIGHTNING PROTECTION SYSTEM SHOULD FOLLOW THE SPECIFICATIONS OF THE LIGHTNING PROTECTION SYSTEM MANUFACTURER.
3. REQUIREMENTS AND RECOMMENDATIONS DETAILED IN SIPLAST SPECIFICATIONS SHALL APPLY IN ADDITION TO THE ABOVE DRAWING.

N.T.S.

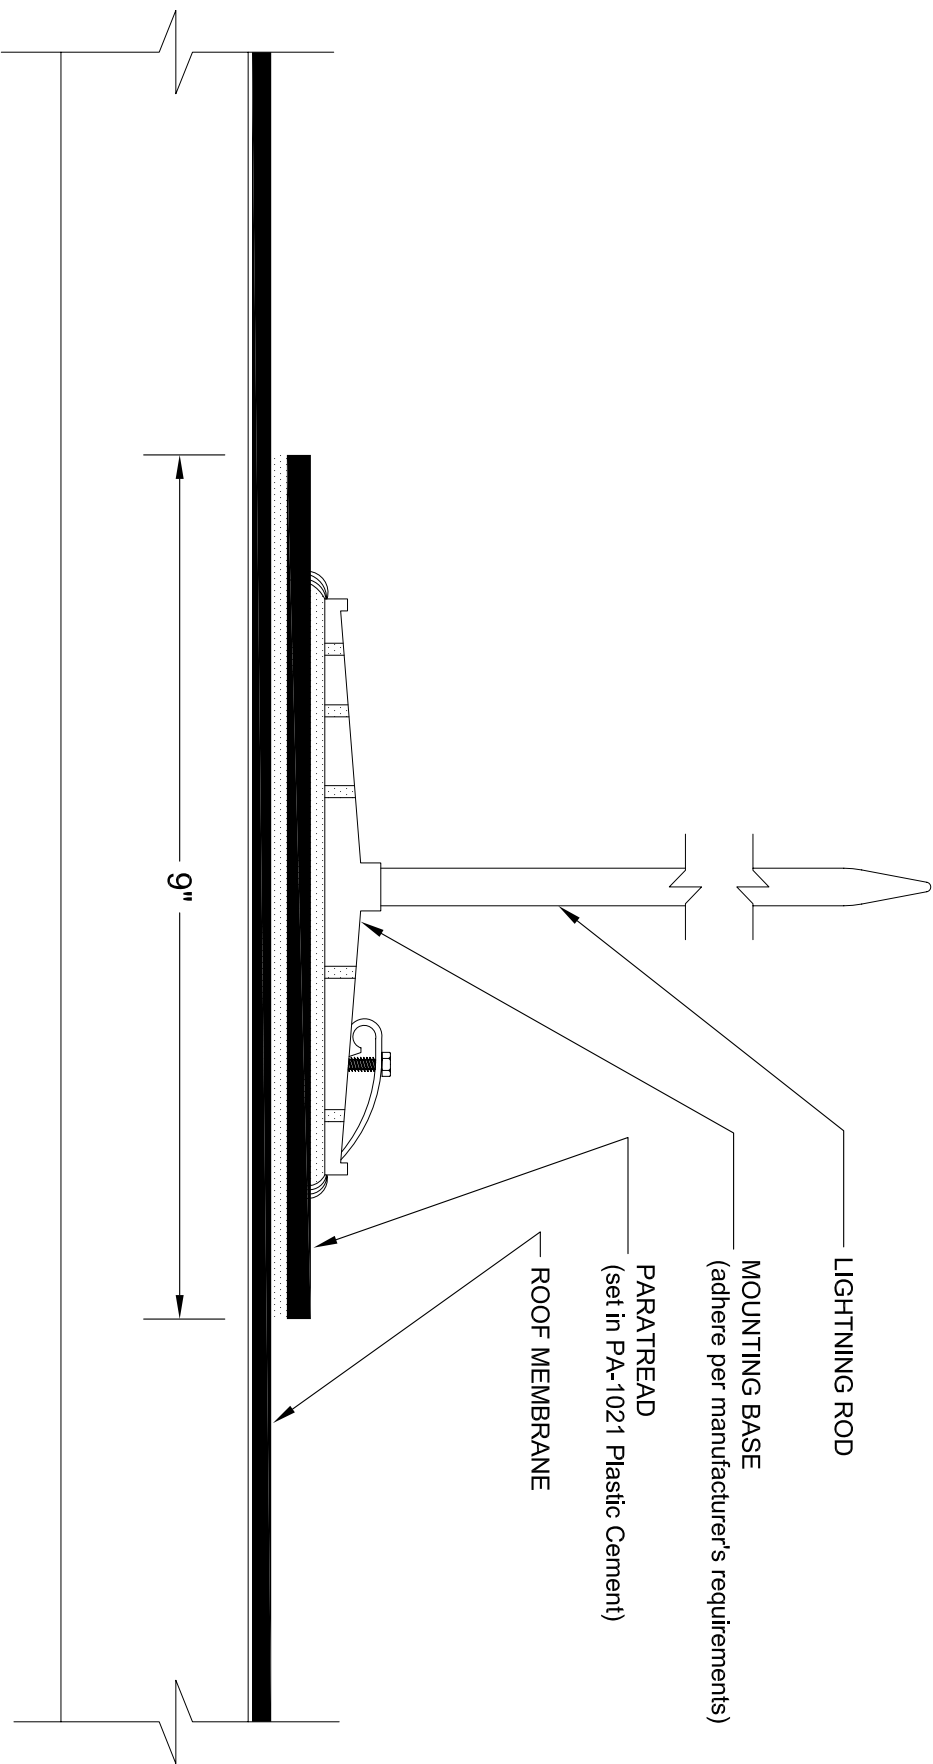

Siplast - 1000 East Rochelle Boulevard - Irving, Texas - 75062-3940
(800) 922-8800 FAX: (469) 995-2206 www.siplast.com

Ref. #: lightning r-m
Date: 12.15.05