


# ROOF VENT



- NOTES:
1. ONE WAY VENTS SHOULD BE PREFABRICATED FROM SPUN ALUMINUM. PLASTIC VENTS ARE NOT ACCEPTABLE.
  2. VENTS SHOULD BE INSTALLED IN ACCORDANCE WITH THE MOST RECENT VERSION OF THE TECHNICAL BULLETIN FOR VENTING SIPLAST ROOF MEMBRANE AND ROOF INSULATION SYSTEMS.
  3. PA-1021 PLASTIC CEMENT AND PA-1125 OR PA-917 LS PRIMER ARE REQUIRED WHERE MASTIC AND PRIMER ARE INDICATED.
  4. REQUIREMENTS AND RECOMMENDATIONS DETAILED IN SIPLAST SPECIFICATIONS SHALL APPLY IN ADDITION TO THE ABOVE DRAWING.
- CAUTION: SIPLAST RECOMMENDS THAT ALL PRACTICES PERTAINING TO NRCA CERTA GUIDELINES BE FOLLOWED WHEN TORCHING METHODS ARE EMPLOYED. THIS INCLUDES PERFORMING A FIRE WATCH FOLLOWING ANY TORCH APPLICATIONS. ALWAYS HAVE APPROVED FIRE-EXTINGUISHING EQUIPMENT NEARBY.

N.T.S.

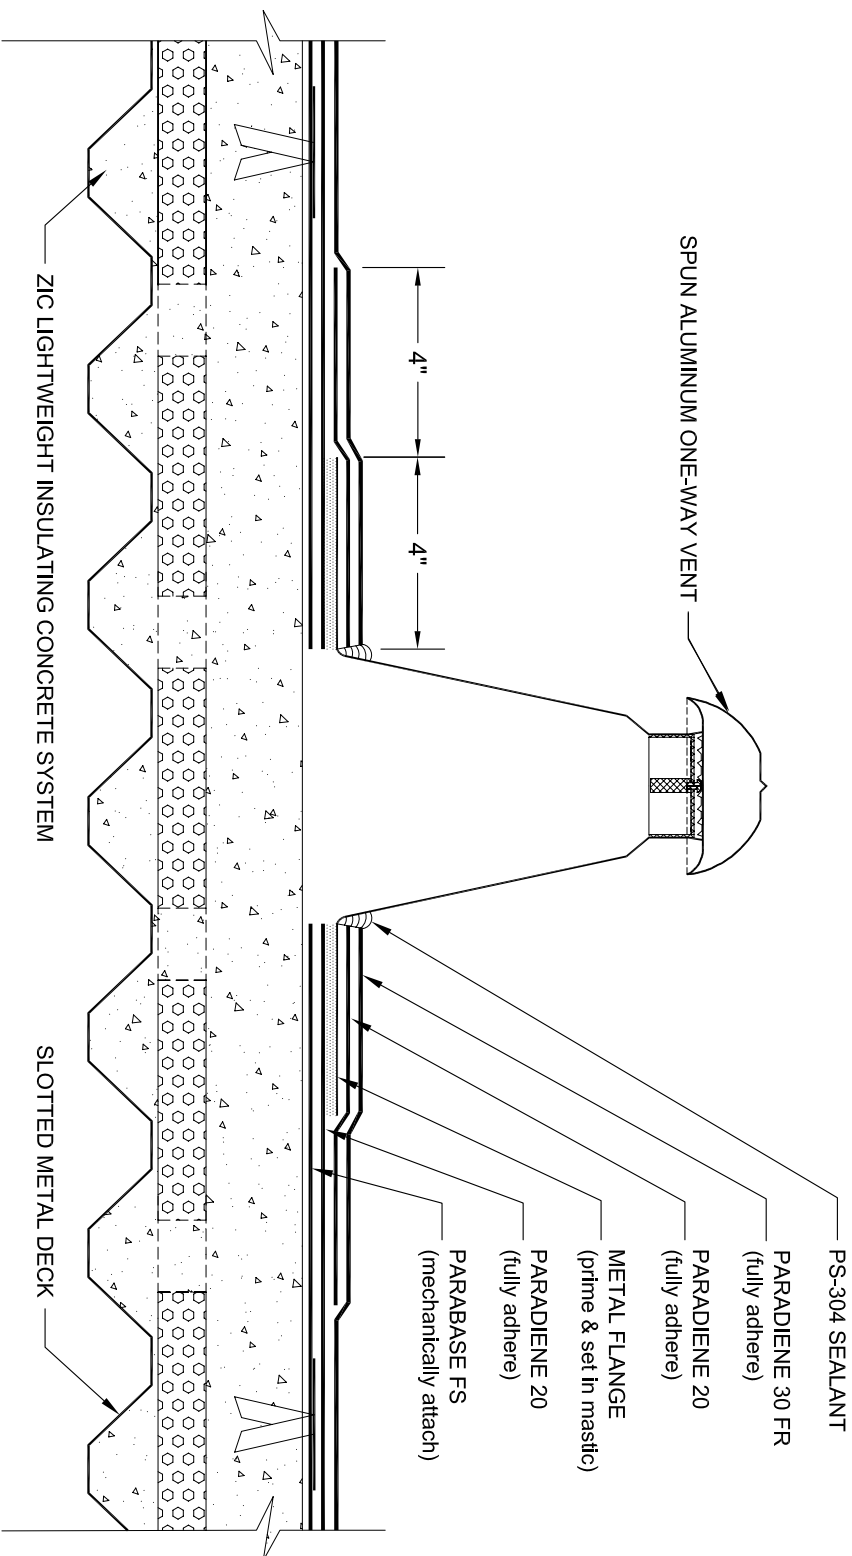

Siplast - 1000 East Rochelle Boulevard - Irving, Texas - 75062-3940  
 (800) 922-8800 FAX: (469) 995-2206 www.siplast.com

Ref. #: 2031zbP4  
 Date: 10.22.08