


# CONCRETE

non-nailable

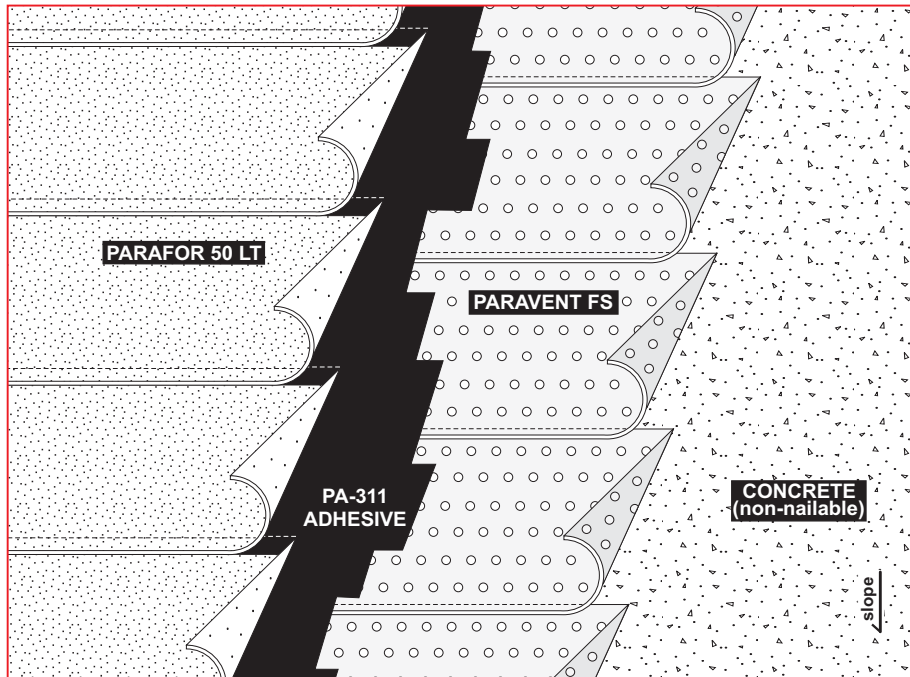

SLOPE 1/2" PER FOOT MIN\*

MATERIALS per 100 sq ft

PARAVENT FS	20 lb
PA-311 ADHESIVE	1 1/2 - 2 1/2 gal
PARAFOR 50 LT	141 lb

\* Contact Siplast for lower slope requirements.

n.t.s.

## SPECIFICATION 5000 CPA

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

### APPLICATION

1. Lay one ply of Paravent FS dry over the entire area to be roofed, lapping sides and ends a maximum of 1 inch.
2. Beginning at the low point of the roof, lay one ply of Parafor 50 LT in a full coating of PA-311 Adhesive, lapping sides a minimum of 4 inches and ends a minimum of 6 inches. Offset end laps a minimum of 3 feet.

**Slopes over 2 1/2" per foot:** Run all plies parallel to the slope of the roof. The Parafor 50 LT must be back-nailed on slopes over 2 1/2" per foot.

