


# CONCRETE OR GYPSUM

## nailable

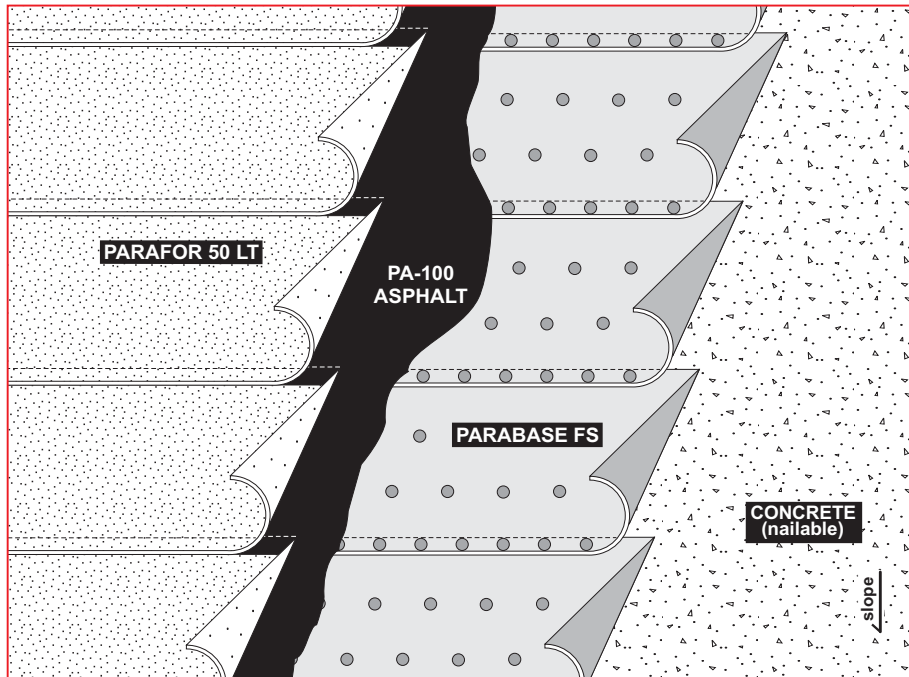

SLOPE  $\frac{1}{2}'' - 2\frac{1}{2}''$  PER FOOT\*

MATERIALS per 100 sq ft

|                |        |
|----------------|--------|
| PARABASE FS    | 20 lb  |
| PA-100 ASPHALT | 25 lb  |
| PARAFOR 50 LT  | 141 lb |

\* Contact Siplast for higher or lower slope requirements.

n.t.s.

### SPECIFICATION 5000 CBH

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

### APPLICATION

1. Lay one ply of Parabase FS dry over the entire area to be roofed. Lap each sheet 3 inches over the underlying sheet and lap ends 6 inches. Using approved fasteners, nail each sheet every 9 inches through the laps and stagger nail the remainder of the sheet in two rows on nominal 12 inch centers with fasteners in each row on 12 inch centers. *The fastening pattern shown in this specification is based on Siplast standard nailing requirements. Contact Siplast for recommended fastening patterns to meet specific testing or code approvals.*
2. Beginning at the low point of the roof, fully mop one ply of Parafor 50 LT to the Parabase FS surface using PA-100 Asphalt, lapping sides a minimum of 4 inches and ends a minimum of 6 inches. Offset end laps a minimum of 3 feet.

**Notes:** The Parafor 50 LT sheets must be back-nailed in all hot asphalt applied specifications.

In certain applications, the sheets may be applied parallel to the slope of the roof. Contact Siplast for requirements.

Venting provisions must be incorporated into lightweight insulating concrete designs.