


PARAPRO MEMBRANE SYSTEM

CONCRETE OR GYPSUM (nailable)

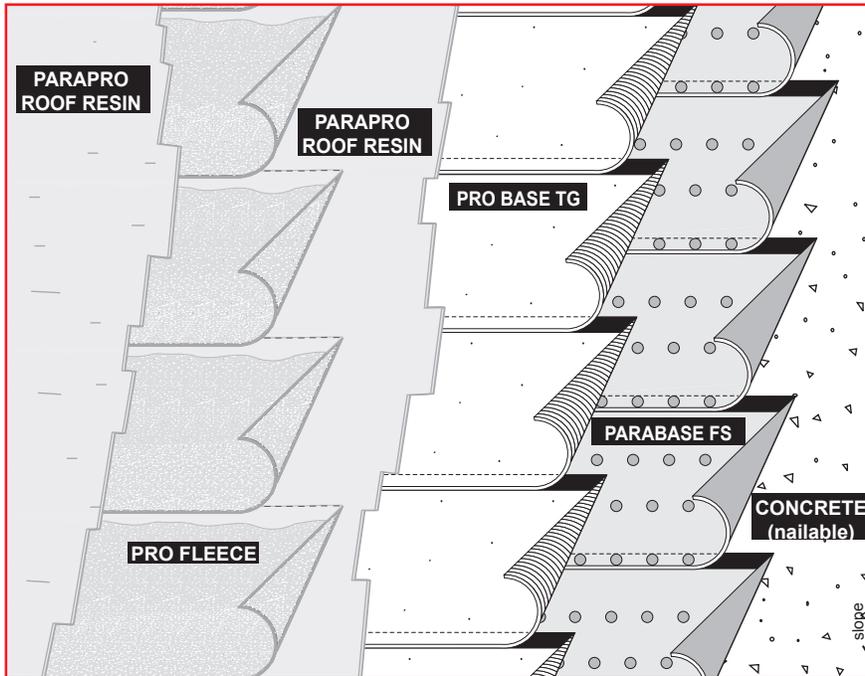

SLOPE 0 -1" per foot*
MATERIALS per 100 sq ft

PARABASE FS	20 lbs
PRO BASE TG	73 lbs
PARAPRO ROOF RESIN	19 kg
PRO FLEECE	
PARAPRO ROOF RESIN	12 kg

SLOPE 0 - 8%*
MATERIALS per sq meter

PARABASE FS	0.9 kg
PRO BASE TG	3.6 kg
PARAPRO ROOF RESIN	2.0 kg
PRO FLEECE	
PARAPRO ROOF RESIN	1.3 kg

n.t.s.

* Contact Siplast for higher slope requirements.

Specification: 24PPR-CBT

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

Application

1. Lay one ply of Parabase FS dry over the entire area to be roofed. Lay each sheet 3 inches over the underlying sheet and lap ends 6 inches. Using approved fasteners, nail each sheet every 9 inches through the laps and stagger nail the remainder of the sheet in two rows on nominal 12 inch centers with fasteners in each row on 12 inch centers. *The fastening pattern shown in this specification is based on Siplast standard nailing requirements. Contact Siplast for the recommended fastening patterns to meet specific testing or code approvals.*
2. Beginning at the low point of the roof, fully torch one ply of Pro Base TG to the Parabase FS surface, lapping sides and ends a minimum of 3 inches.
3. Apply an even, generous base coat of catalyzed Parapro Roof Resin over the Pro Base TG surface using an approved roller at a rate of 19 kilograms per square.
4. While the previously applied catalyzed Parapro Roof Resin is still wet, install Pro Fleece reinforcement, embedding the fleece into the resin using a roller. Ensure that no air is trapped beneath the fleece. Lap the fleece a minimum 2 inches side and end, and apply an additional coat of catalyzed Parapro Roof Resin between layers of overlapping fleece.
5. Immediately following embedment of the Pro Fleece reinforcement, apply an even, generous top coat of catalyzed Parapro Roof Resin at a rate of 12 kilograms per square, ensuring full saturation of the fleece.

Caution: Siplast recommends that all practices pertaining to NRCA CERTA guidelines be followed when torching methods are employed. This includes performing a fire watch following any torch applications. Always have approved fire-extinguishing equipment nearby.

Ref. #: Concrete or Gypsum - Parabase FS - ProBaseTG - Ppro
Rev: 12.17.18