


# CONCRETE OR GYPSUM nailable

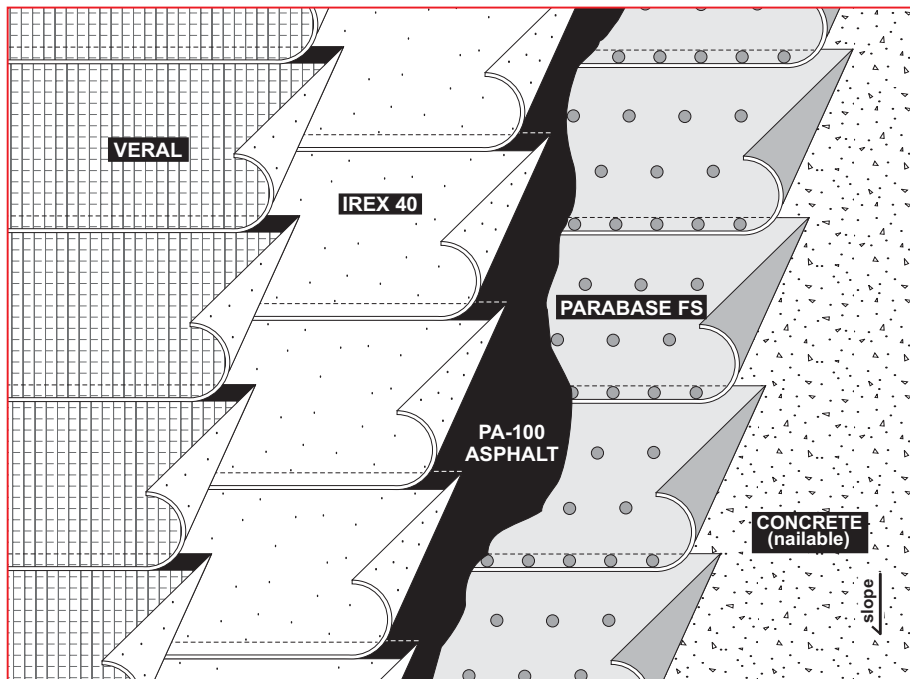

<b>SLOPE</b>	$\frac{1}{2}''$ to $2\frac{1}{2}''$ *
<b>MATERIALS</b>	per 100 sq ft
<b>PARABASE FS</b>	20 lb
<b>PA-100 ASPHALT</b>	25 lb
<b>IREX 40</b>	85 lb
<b>VERAL ALUMINUM</b>	96 lb

\* Contact Siplast for lower or higher slope requirements.

n.t.s.

## SPECIFICATION 4040 CBH-T

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

### APPLICATION

1. Lay one ply of Parabase FS dry over the entire area to be roofed. Lap each sheet 3 inches over the underlying sheet and lap ends 6 inches. Using approved fasteners, nail each sheet every 9 inches through the laps and stagger nail the remainder of the sheet in two rows on nominal 12 inch centers with fasteners in each row on 12 inch centers. *The fastening pattern shown in this specification is based on Siplast standard nailing requirements. Contact Siplast for recommended fastening patterns to meet specific testing or code approvals.*
2. Beginning at the low point of the roof, fully mop one ply of Irex 40 to the Parabase FS surface using PA-100 Asphalt, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet.
3. Beginning again at the low point of the roof, fully torch one ply of Veral Aluminum to the Irex 40 surface, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet. Stagger laps between plies.

**Slopes over  $2\frac{1}{2}''$  per foot:** Run plies parallel to the slope of the roof. Both the Irex and Veral must be backnailed on slopes in excess of  $3\frac{1}{2}''$  per foot.

**NOTES:** Prime foil surfaces to be lapped by adjoining sheets.  
Venting provisions must be incorporated into lightweight insulating concrete designs.

**Caution:** Siplast recommends that all practices pertaining to NRCA CERTA guidelines be followed when torching methods are employed. This includes performing a fire watch following any torch applications. Always have approved fire-extinguishing equipment nearby.

Ref #: Irex-h Veral LWC-base  
Rev: 10.29.09



1000 East Rochelle Boulevard Irving, Texas 75062 (800) 922-8800 FAX (469) 995-2206



An Icopal Group Company