


CONCRETE OR GYPSUM nailable

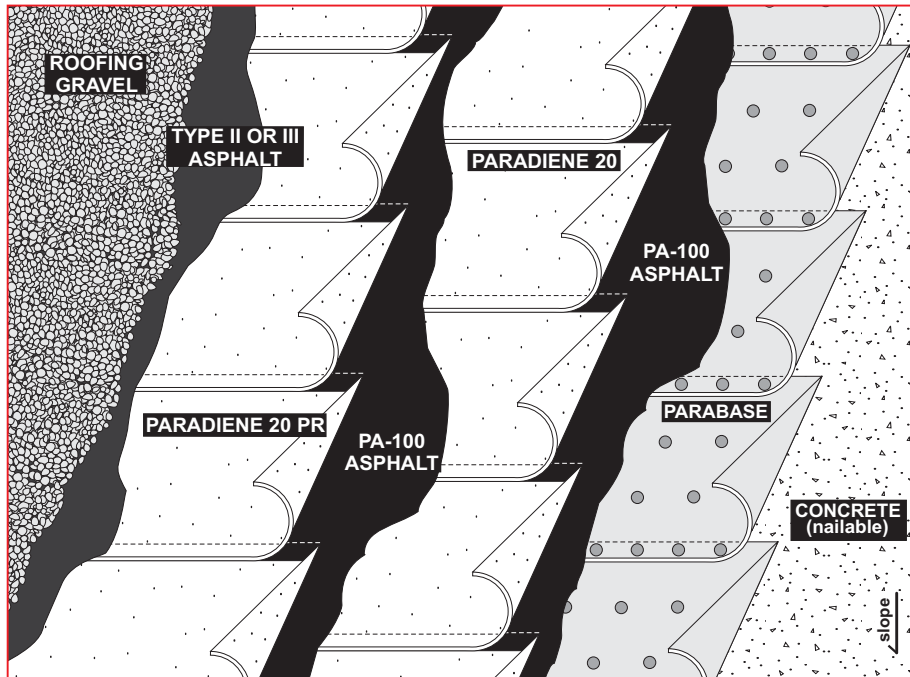

SLOPE 0"- 1/2" PER FOOT

MATERIALS per 100 s.f.

PARABASE FS	20 lbs.
PA-100 ASPHALT	25 lbs.
PARADIENE 20	62 lbs.
PA-100 ASPHALT	25 lbs.
PARADIENE 20 PR	60 lbs.
TYPE II OR III ASPHALT	60 lbs.
ROOFING GRAVEL	400 lbs.

* Contact Siplast for higher slope requirements.

n.t.s.

SPECIFICATION 2020PR CBH-G

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

APPLICATION

1. Lay one ply of Parabase FS over the entire area to be roofed. Lap each sheet 4 inches over the underlying sheet and lap ends 6 inches. Using approved fasteners, nail each sheet every 9 inches through the laps and stagger nail the field of the sheet in two rows, each on 12 inch centers. *The fastening pattern shown in this specification is based on Siplast standard nailing requirements. Contact Siplast for recommended fastening patterns to meet specific testing or code approvals.*
2. Beginning at the low point of the roof, fully mop one ply of Paradiene 20 to the Parabase surface, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet.
3. Beginning again at the low point of the roof, fully mop one ply of Paradiene 20 PR to the Paradiene 20 surface, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet. Stagger laps between plies.
4. Embed the gravel surfacing at a rate of 400 lbs. per square in a flood coat of Type II or Type III asphalt.

Note: Venting provisions must be incorporated into lightweight insulating concrete designs.



1000 East Rochelle Boulevard Irving, Texas 75062 (800) 922-8800 FAX (469) 995-2206

Ref. #: P20-h P20PR-h LWC-base Gravel-h
Rev. 11/02.09



An Icopal Group Company