

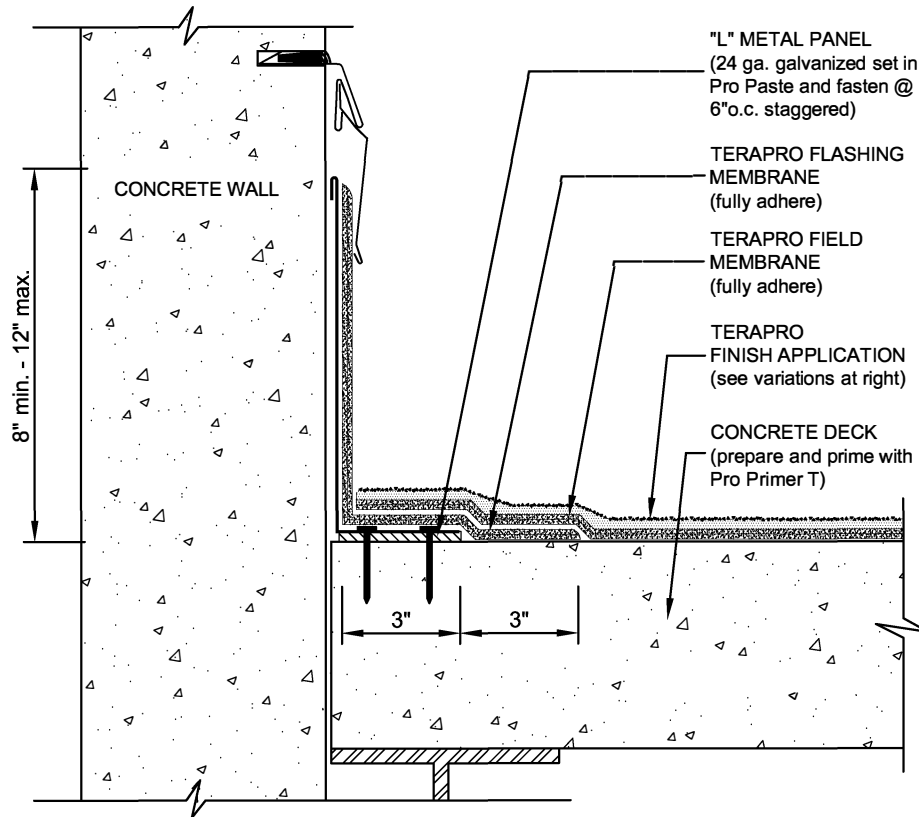
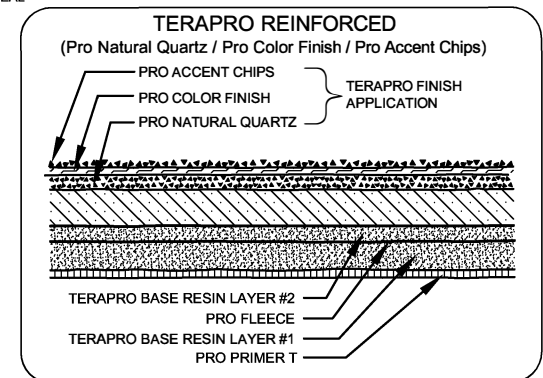
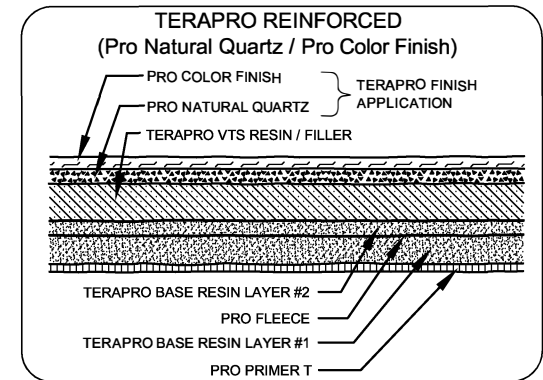


INDEPENDENT WALL FLASHING

TERAPRO (REINFORCED) - CONCRETE SUBSTRATE

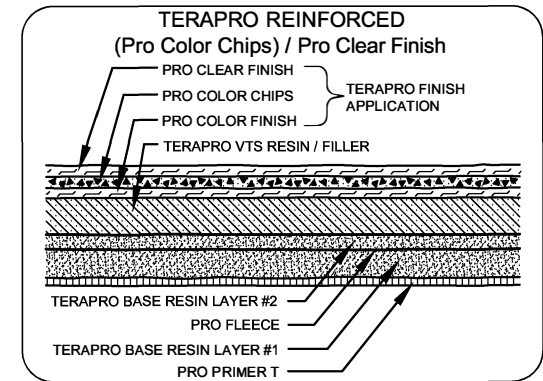

L-METAL INSTALLATION JOINT TREATMENT

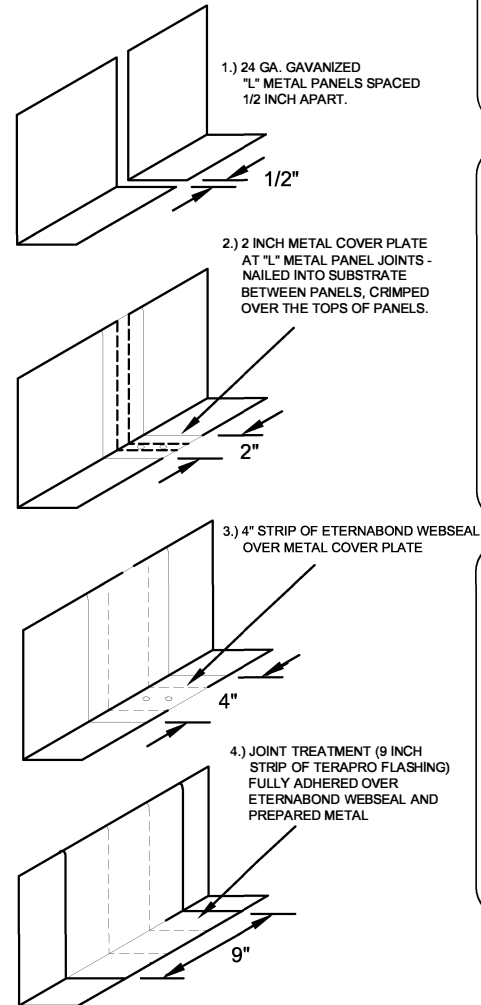

- NOTES: 1. REFER TO SIPLAST PREPARATION GUIDELINES FOR PROPER SURFACE TREATMENT OF ALL MATERIALS PRIOR TO APPLICATION OF TERAPRO MATERIAL.
2. TREAT JOINTS BETWEEN SECTIONS OF "L" METAL WITH A 2" COVER PLATE AND A 6 INCH WIDE TREATMENT OF RESIN/FLEECE/RESIN.
3. REQUIREMENTS AND RECOMMENDATIONS DETAILED IN TERAPRO INSTALLATION SPECIFICATIONS SHALL APPLY IN ADDITION TO THE ABOVE DRAWING.

N.T.S.