
## CONCRETE OR GYPSUM

## nailable

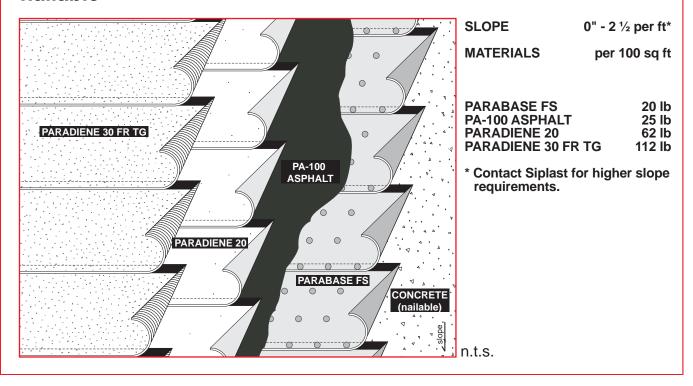

Specification: 2030 CBH-T

Requirements and recommendations detailed in the Siplast catalog and Siplast long form specifications shall apply in addition to the following recommendations and specifications.

## **Application**

- 1. Lay one ply of Parabase FS dry over the entire area to be roofed. Lap each sheet 3 inches over the underlying sheet and lap ends 6 inches. Using approved fasteners, nail each sheet every 9 inches through the laps and stagger nail the remainder of the sheet in two rows on nominal 12 inch centers with fasteners in each row on 12 inch centers. The fastening pattern shown in the specification is based on Siplast standard nailing requirements. Contact Siplast for recommended fastening patterns to meet specific testing or code approvals.
- 2. Beginning at the low point of the roof, fully mop one ply of Paradiene 20 to the Parabase FS surface using PA-100 Asphalt, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet.
- 3. Beginning again at the low point of the roof, fully torch one ply of Paradiene 30 FR TG to the Paradiene 20 surface, lapping sides and ends a minimum of 3 inches. Offset end laps a minimum of 3 feet. Stagger laps between plies.

Notes: Torch prime all granule surfaces to be lapped by adjoining sheets.

Venting provisions must be incorporated into lightweight insulating concrete designs.

Caution: Siplast recommends that all practices pertaining to NRCA CERTA guidelines be followed when torching

methods are employed. This includes performing a fire watch following any torch applications. Always

have approved fire-extinguishing equipment nearby.

Ref. #: P20-h P30-tg LWC-base Date: 11.2.09



