


PARAGUARD ROOF DRAIN PARASOLO HYBRID SYSTEM - INSULATED

LEGEND

SEALANT

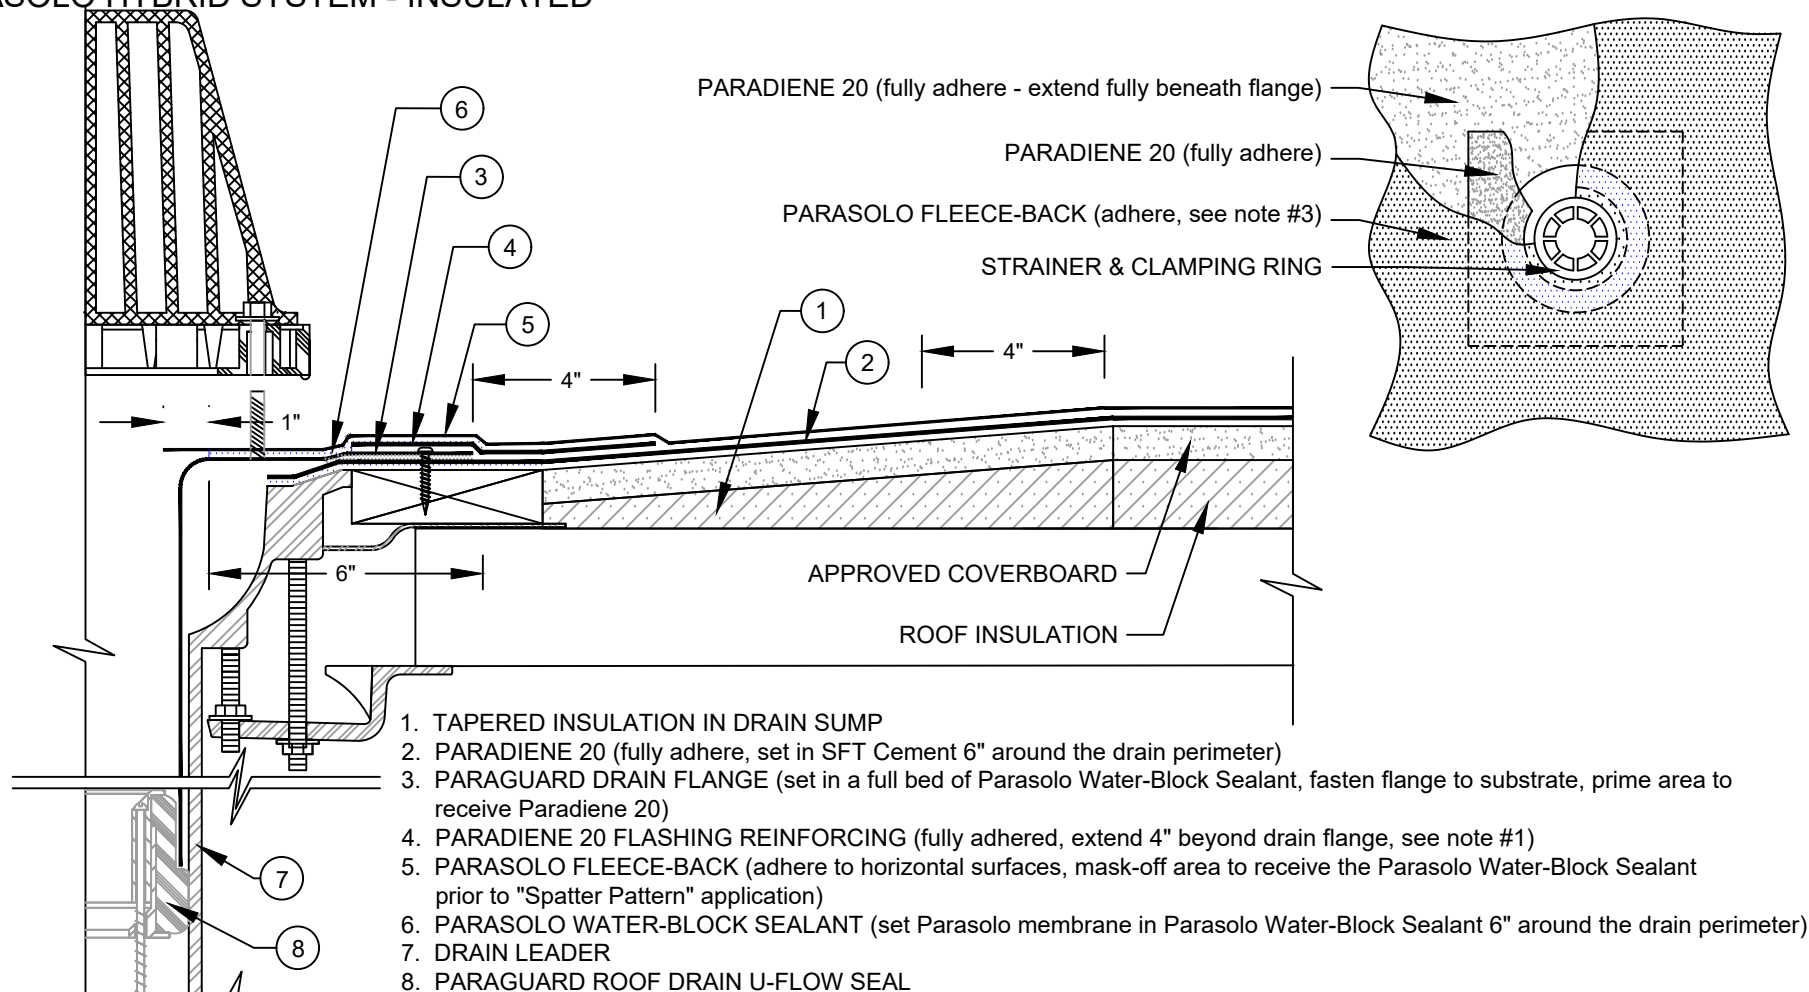

1. TAPERED INSULATION IN DRAIN SUMP
2. PARADIENE 20 (fully adhere, set in SFT Cement 6" around the drain perimeter)
3. PARAGUARD DRAIN FLANGE (set in a full bed of Parasolo Water-Block Sealant, fasten flange to substrate, prime area to receive Paradiene 20)
4. PARADIENE 20 FLASHING REINFORCING (fully adhered, extend 4" beyond drain flange, see note #1)
5. PARASOLO FLEECE-BACK (adhere to horizontal surfaces, mask-off area to receive the Parasolo Water-Block Sealant prior to "Spatter Pattern" application)
6. PARASOLO WATER-BLOCK SEALANT (set Parasolo membrane in Parasolo Water-Block Sealant 6" around the drain perimeter)
7. DRAIN LEADER
8. PARAGUARD ROOF DRAIN U-FLOW SEAL

NOTES:

1. WHERE FLASHING REINFORCING IS INDICATED TO MAINTAIN PROPER ADHESION, USE PA-1125 OR PA-917 LS PRIMER. CONTACT SIPLAST FOR SPECIFIC REQUIREMENTS.
 2. FOLLOW SIPLAST SPECIFICATIONS FOR INSTALLATION OF PARAGUARD ROOF DRAIN COMPONENTS.
 3. MEMBRANE MUST EXTEND MINIMUM 1" BEYOND THE BOLTS. THE CLAMPING RING BOLTS MUST PENETRATE THE MEMBRANE.
 4. REQUIREMENTS AND RECOMMENDATIONS DETAILED IN THE CURRENT SIPLAST SPECIFICATIONS SHALL APPLY IN ADDITION TO THE ABOVE DRAWING.
- CAUTION: SIPLAST RECOMMENDS THAT ALL PRACTICES PERTAINING TO INDUSTRY STANDARD TORCH SAFETY REQUIREMENTS AND GUIDELINES BE FOLLOWED. THIS INCLUDES PERFORMING A FIRE WATCH FOLLOWING ANY TORCH APPLICATIONS. ALWAYS HAVE APPROVED FIRE EXTINGUISHING EQUIPMENT NEARBY WHEN USING A TORCH.

Scale: NTS

REF: PARAGUARD ROOF DRAIN - PARASOLO - P20 - INSULATED

Detail Number:
DE-SP-37-02e



14911 Quorum Drive, Suite 600 - Dallas, Texas - 75254 (800) 922-8800

www.siplast.com

Rev: 06.06.2023